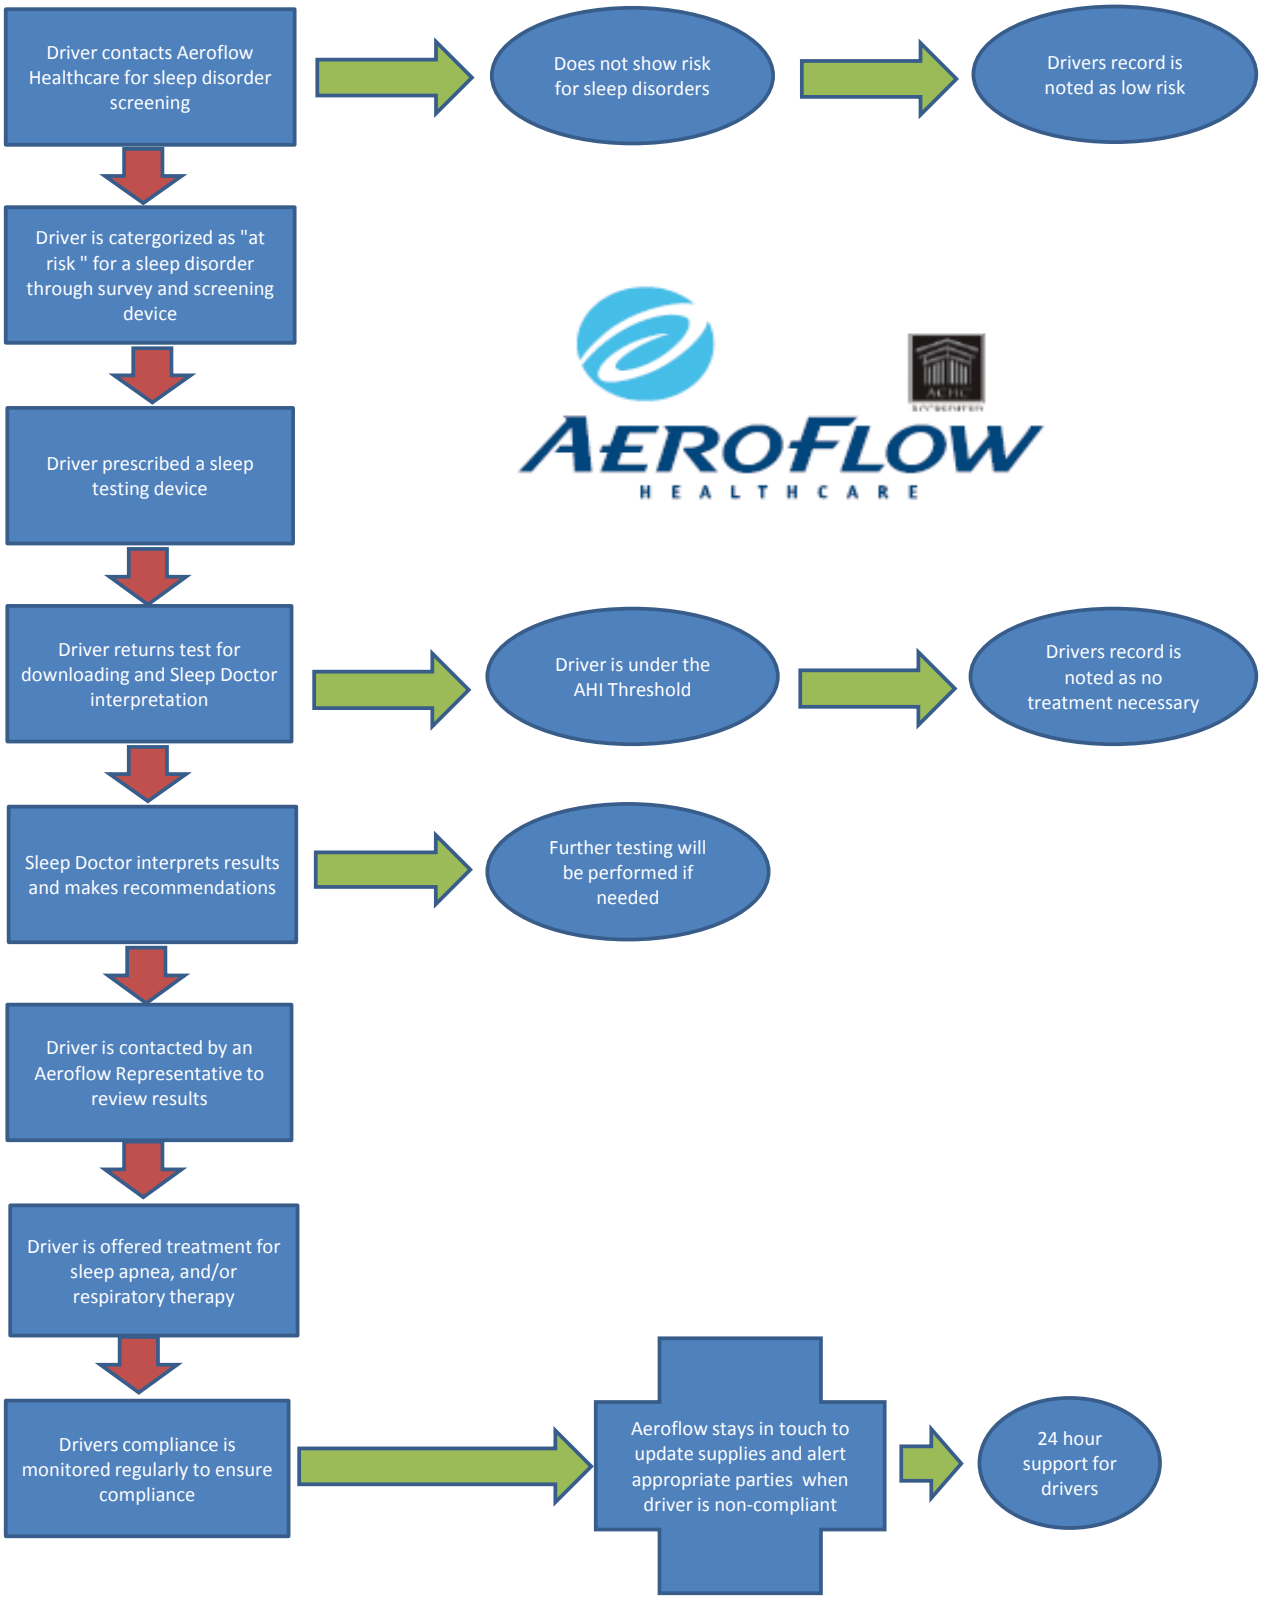
Driver contacts Aeroflow Healthcare for sleep disorder screening
Does not show risk for sleep disorders
Drivers record is noted as low risk
Driver is catergorized as "at risk " for a sleep disorder through survey and screening device
AEROFLOW
HEALTHCARE
Driver prescribed a sleep testing device
Driver returns test for downloading and Sleep Doctor interpretation
Driver is under the AHI Threshold
Drivers record is noted as no treatment necessary
Sleep Doctor interprets results and makes recommendations
Further testing will be performed if needed
Driver is contacted by an Aeroflow Representative to review results
Driver is offered treatment for sleep apnea, and/or respiratory therapy
Drivers compliance is monitored regularly to ensure compliance
Aeroflow stays in touch to update supplies and alert appropriate parties when driver is non-compliant
24 hour support for drivers